

Dimensional Information Needed For Air Intake Filter Price Quotations


Provide The Following Info.

- Make & Model
- Dimensions as indicated on drawing below.
- Number of intake opening per unit. (eg., one – face only , two – 1 face & 1 back)
- How high above grade is the tower.
- How many towers of each model.

On some cooling towers it may be necessary to attach metal flashing on the sides, top or bottom to block off small gaps where air overflow can occur. When using the Stud Adaptor filter, the filter must overlap the air intake opening by 11/2” – 2” on all sides.

When using the Pulley-mount filter, the storage container can be affixed to the structural steel supporting the tower or, can be mounted to the face of the tower at the top of the basin.

Single Cell Cooling Towers

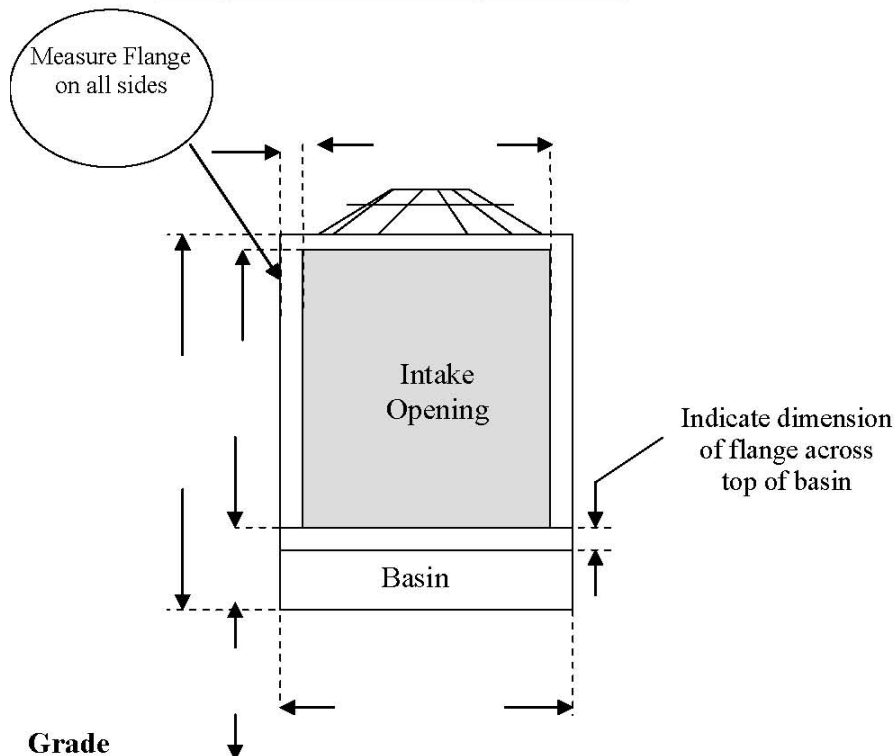

Customer Contact:

Company:

Tel. _____

Fax: _____

Email: _____

End Customer:

Equip. Make / Model:

Notes / Comments: